




## Rated wall to non-rated roof/ceiling assembly

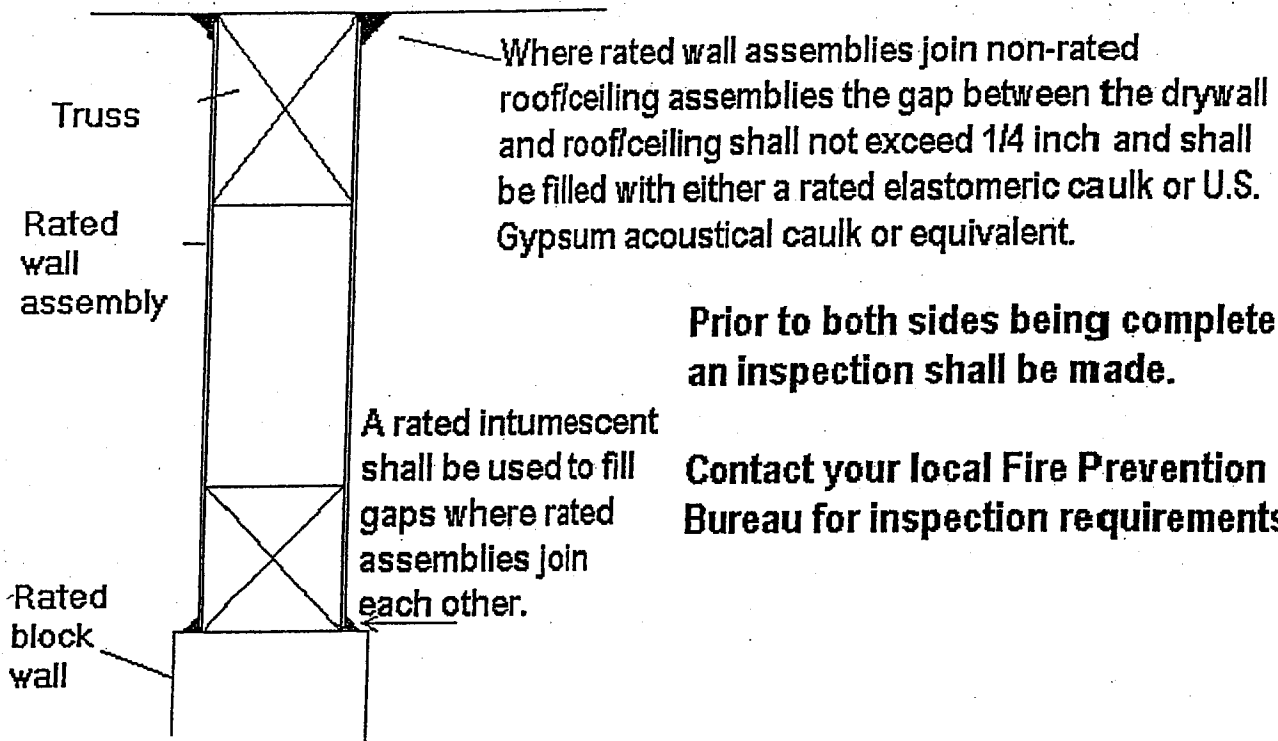


## Cross corrugation sealing of rated walls to non-rated roof/ceiling assemblies

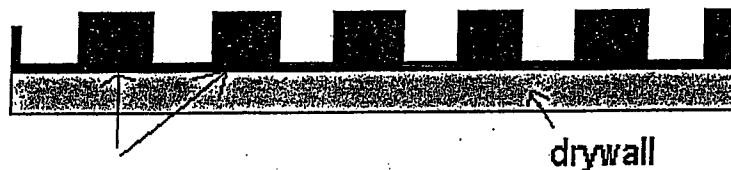

Cells shall be packed with mineral wool, then covered with a rated elastomeric caulk or rated spray type fire stop system.

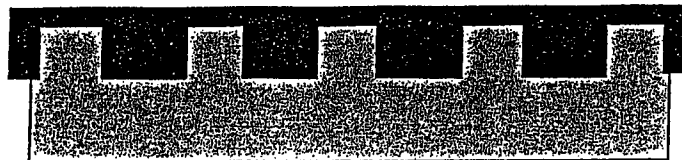

Drywall cut to fit-cells filled with mineral wool-gaps not to exceed 1/4 inch. Gaps shall be filled with either a rated elastomeric caulk or U.S. Gypsum acoustical caulk or equivalent.

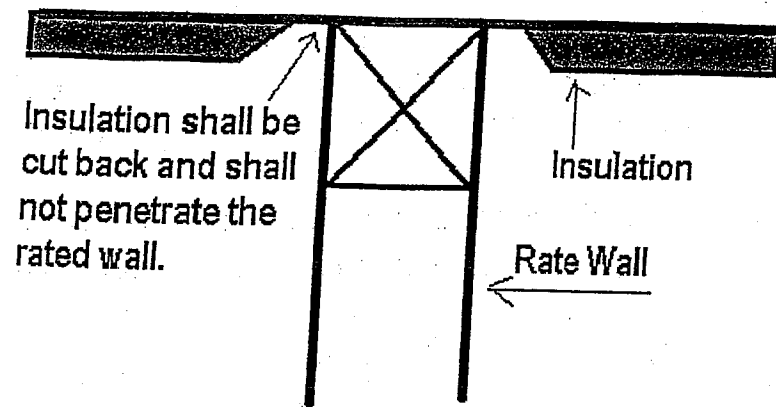

**Engineering Judgments to contrary shall not be accepted.**

---